


FLUSH WITH GRADE  
 CAST IRON VALVE BOX LID  
 (SEE SPECIFICATIONS)

VALVE BOX SETTING

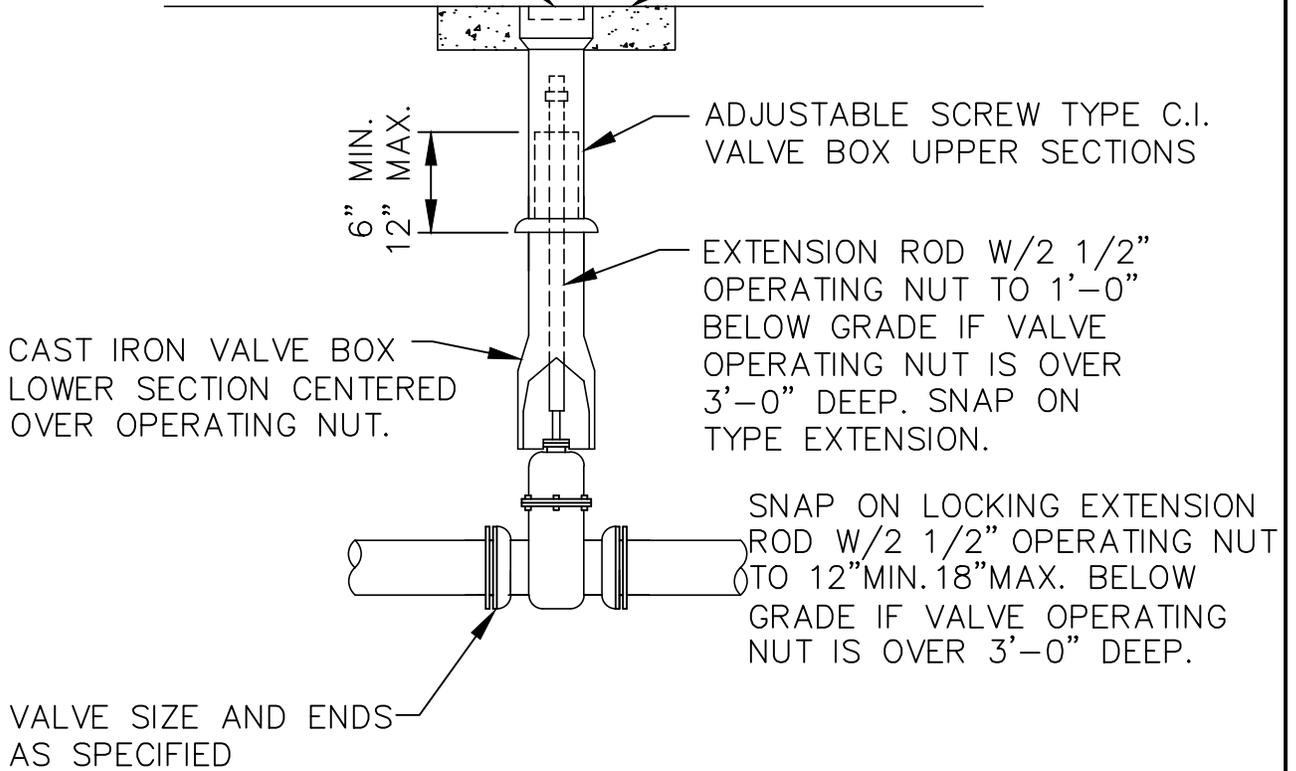

NOTE: ALL LIDS MUST SAY "REUSE WATER"

## VALVE BOX SETTING FOR GATE ( WITH OUT GEAR OPERATION )

USE MEGALUGS AT ALL PIPE JOINTS

### ENGINEERING STANDARDS 2015

REVISIONS		ENGINEERING DIVISION CITY OF POMPANO BEACH	<b>VALVE BOX SETTING ( WITH OUT GEAR OPERATION )</b>	
BY	DATE			
S.S.	2/06/12		DATE: MAY 2007	
			DWG. NO.	
		SCALE: N.T.S.	<b>501-1</b>	