


J:\City-STANDARDS\Sanitary 2-3.dwg, 11/24/2014 2:37:35 PM

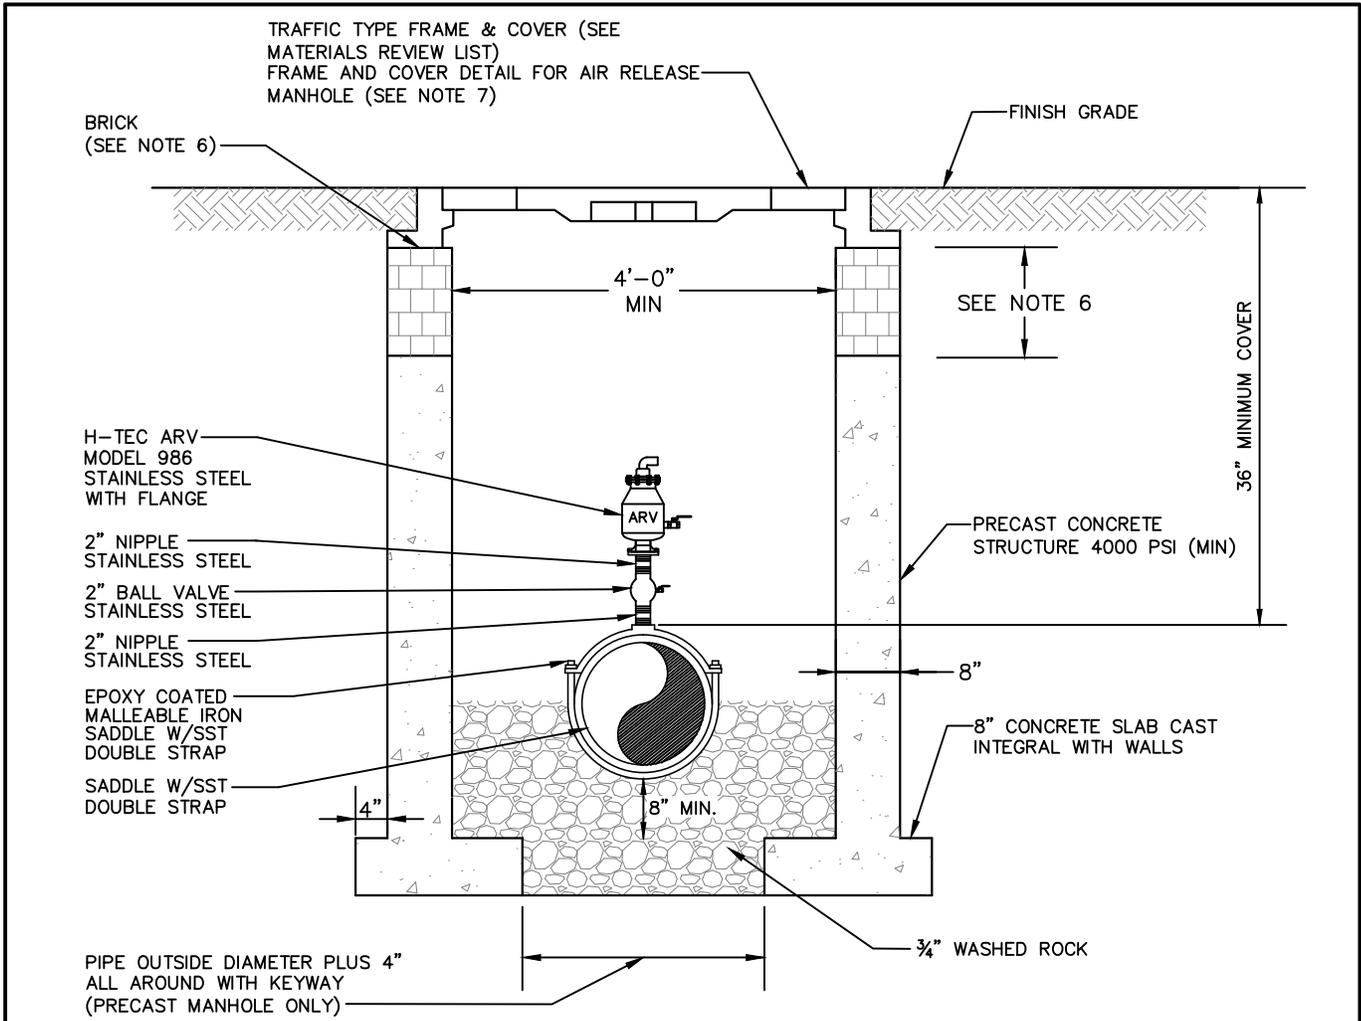

**NOTES:**

1. BALL VALVE, PIPING, ETC., TO MATCH AIR RELEASE VALVE DIAMETER.
2. MISCELLANEOUS ARV ACCESSORIES SHALL BE SELF-CONTAINED AUTOMATIC PROCESS VALVES.
3. RAMNEK AT ALL RISER JOINTS WITH GROUT ON INSIDE AND OUTSIDE AT ALL RISER JOINTS.
4. MANHOLE FABRICATION SHALL BE IN ACCORDANCE WITH ASTM C-478, LATEST STANDARD.
5. COAT INSIDE AND OUTSIDE OF MANHOLE WITH PROTECTIVE COATINGS.
6. THE CHIMNEY AREA SHALL BE A MINIMUM OF 4" AND A MAXIMUM OF 12" IN HEIGHT. A MINIMUM OF 3 COURSES OF BRICK SHALL BE INSTALLED. SET IN 2 STRIPS OF SEALANT/ADHESIVE COMPOUND ON EACH SEALING FACE.
7. SET MANHOLE FRAME ON 2 STRIPS OF SEALANT PLUS A BED OF PORTLAND CEMENT AND SILICA SAND. BRING MORTAR UP OVER FRAME.

**SEWAGE AIR RELEASE VALVE**

**ENGINEERING STANDARDS 2015**

REVISIONS		ENGINEERING DIVISION CITY OF POMPANO BEACH	<b>SEWAGE AIR RELEASE VALVE</b>	
BY	DATE			
S.S.	JUNE 2005	SCALE: N.T.S.	DATE: JUNE 1996	
S.S.	01/30/12		DWG. NO. <b>217-1</b>	