


FLUSH WITH GRADE
 CAST IRON VALVE BOX LID
 (SEE SPECIFICATIONS)

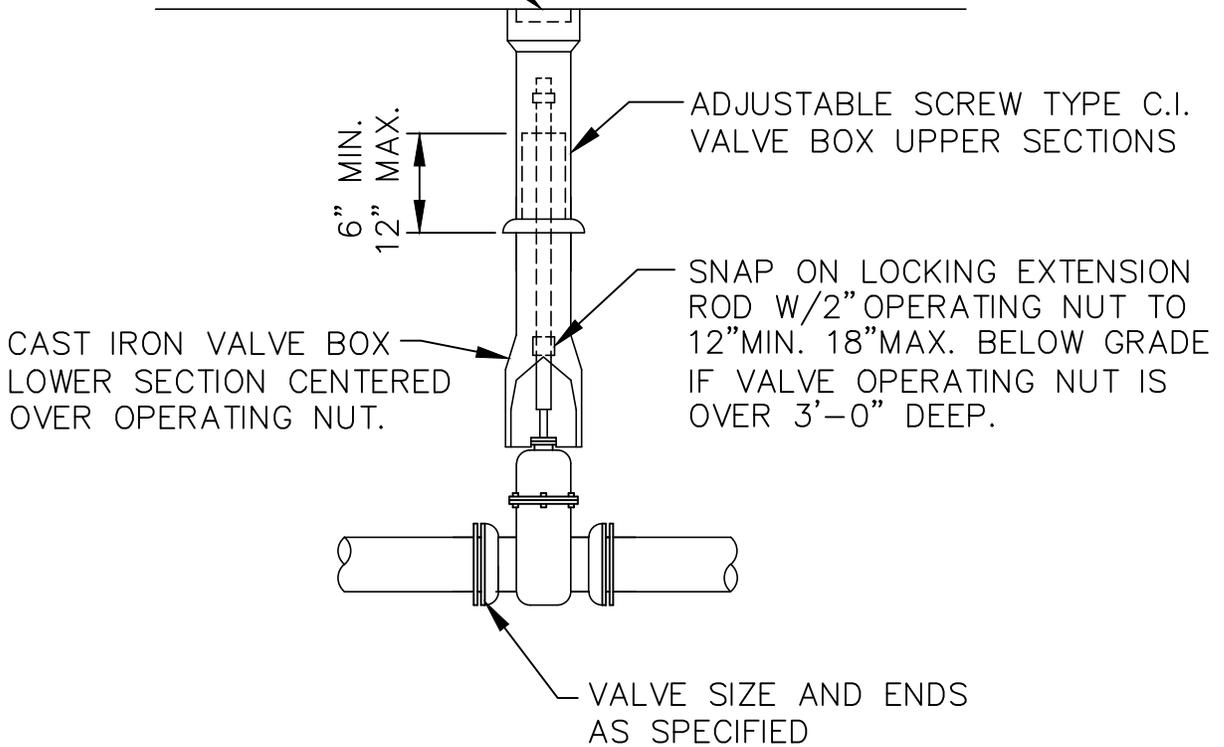

GATE OR PLUG VALVE SETTING

USE MEGALUGS AT ALL PIPE JOINTS

ALL D.I.P. TO BE PAINTED
 BLUE ON TOP HALF OF PIPE.

ENGINEERING STANDARDS 2015

REVISIONS		ENGINEERING DIVISION CITY OF POMPANO BEACH	GATE OR PLUG VALVE SETTINGS	
BY	DATE		DATE: JUNE 1996 DWG. NO. 103-1	
S.S.	04-2005	SCALE: N.T.S.		
T.W.	11-2007			SCALE: N.T.S.
		SCALE: N.T.S.		
				SCALE: N.T.S.