
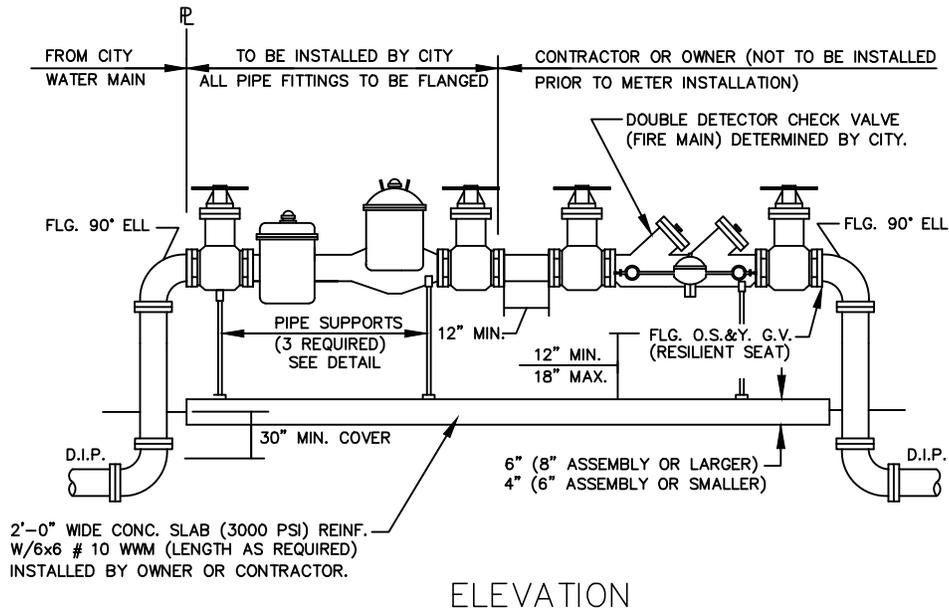


ADJUSTABLE PIPE SUPPORT PER 204-1
SANITARY DETAIL (BY CONTRACTOR OR OWNER)

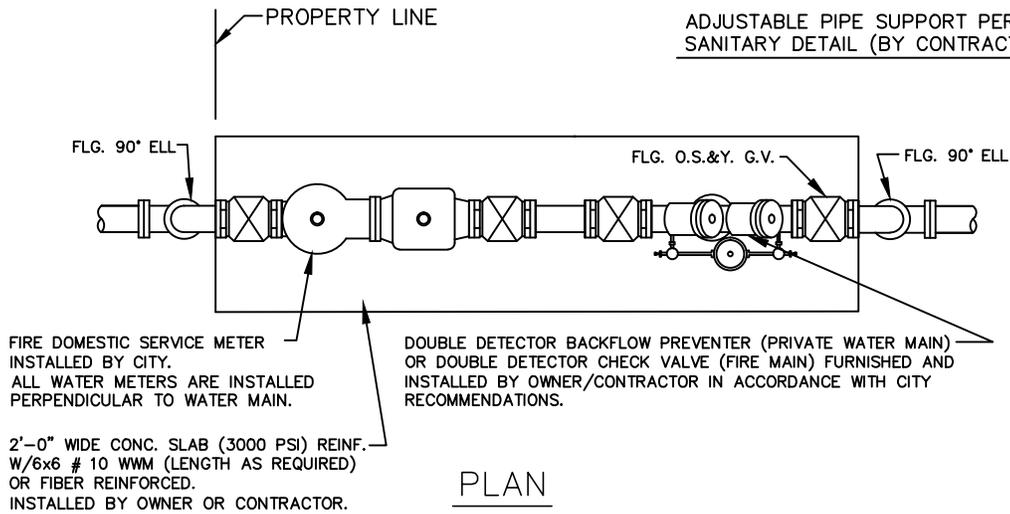

FIRE ONLY METER AND BACKFLOW DEVICE DETAILS

NOTES:

1. THE BACKFLOW PREVENTOR FOR THE BY-PASS SHALL BE DDCV OR RPZ.
2. METERS MUST BE PAID IN ADVANCE AS THEY ARE SUBJECT TO A LONG LEAD DELIVERY TIME. CONTACT CUSTOMER SERVICE AT 954-786-4637 TO ARRANGE FOR METER INSTALLATION.
3. USE MEGALUGS AT ALL PIPE JOINTS
4. PLEASE SEE METER INSTALL DIMENSION LIST ON STANDARD NO. 106-4

ENGINEERING STANDARDS 2015

REVISIONS		ENGINEERING DIVISION CITY OF POMPANO BEACH	FIRE ONLY METER AND BACKFLOW DEVICE
BY	DATE		
S.S.	03-2009		
S.S.	05-2011		
S.S.	11-2012		
S.S.	12-2013	SCALE: N.T.S.	DATE: JUNE 1996 DWG. NO. 106-3