


PLAN

** ALL WATER METERS ARE INSTALLED PERPENDICULAR TO WATER MAIN.

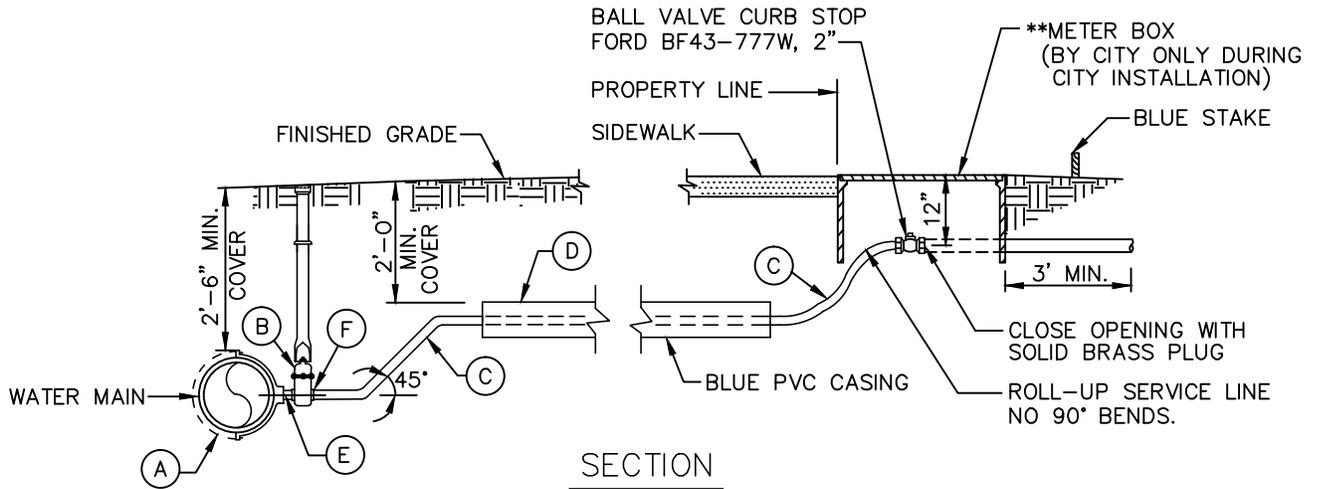

SECTION

- (A) 2" TAPPING SADDLE IRON PIPE
THREADED FORD FC-202 OR EQUAL.
- (B) 2" RESILIENT SEATED GATE VALVE
CLOW F61-03
MUELLER A-23-60-8
2" OPERATING NUT BOXED TO GRADE - C.I. BOX
- (C) 2" POLYETHYLENE BLUE
- (D) 2 1/2" SCH. 40
- (E) 2" X 3" BRASS NIPPLE
- (F) 2" MIP COUPLING C-84-77 - PACK JOINT - CTS

TYPICAL 2" WATER SERVICE

ENGINEERING STANDARDS 2015

REVISIONS		ENGINEERING DIVISION CITY OF POMPANO BEACH	TYPICAL 2" WATER SERVICE	
BY	DATE		DATE: APRIL 2004 DWG. NO. 107-2	
T.W.	11-2007			
T.W.	08-2009			
S.S.	05-2011			
S.S.	05-2012	SCALE: N.T.S.		